

QUICK INSTALLATION


ML

IXTRA M

Monobloc heat pump air to water





Outdoor unit

IXTRA M 12	☐
IXTRA M 15	☐
IXTRA M 12tri	☐
IXTRA M 15tri	☐
IXTRA M 17tri	☐

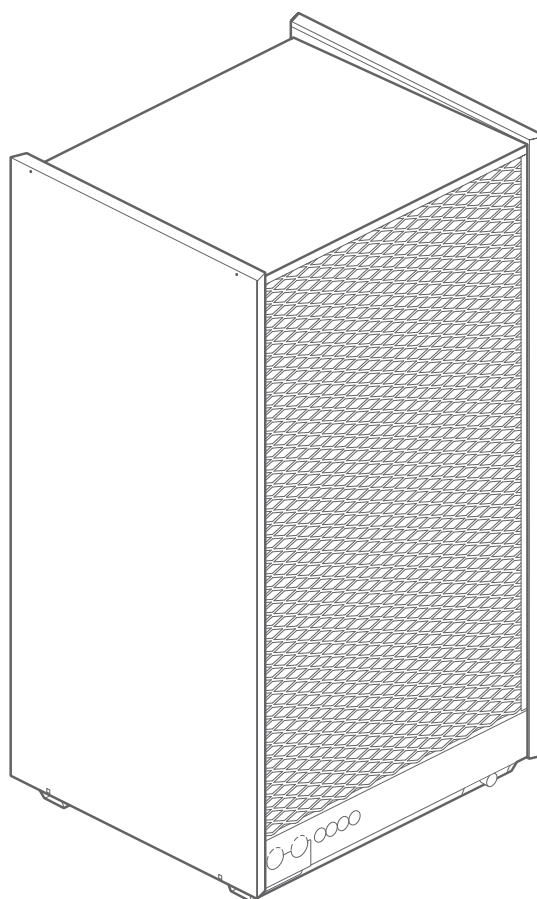

U0732474_2325_ML_2
13/02/2023

For professionals.
To be kept by the user for future reference

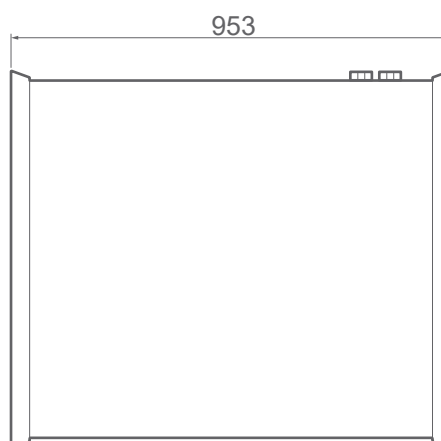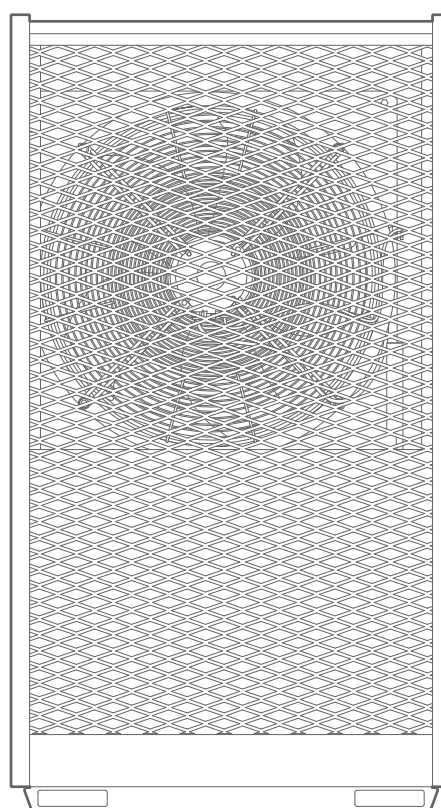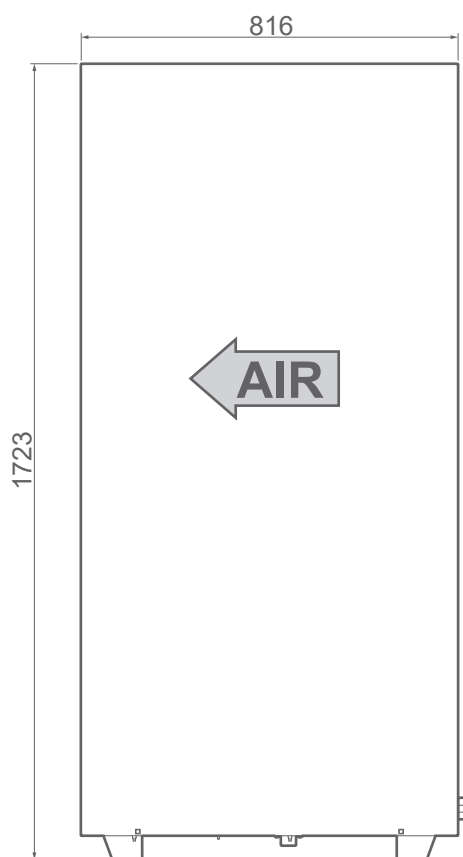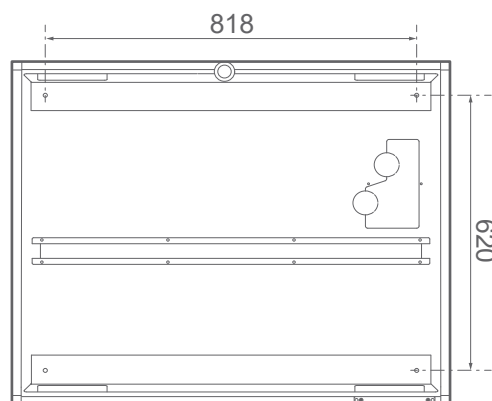


IXTRA M 12-15


IXTRA M 12tri-15tri-17tri

250 kg




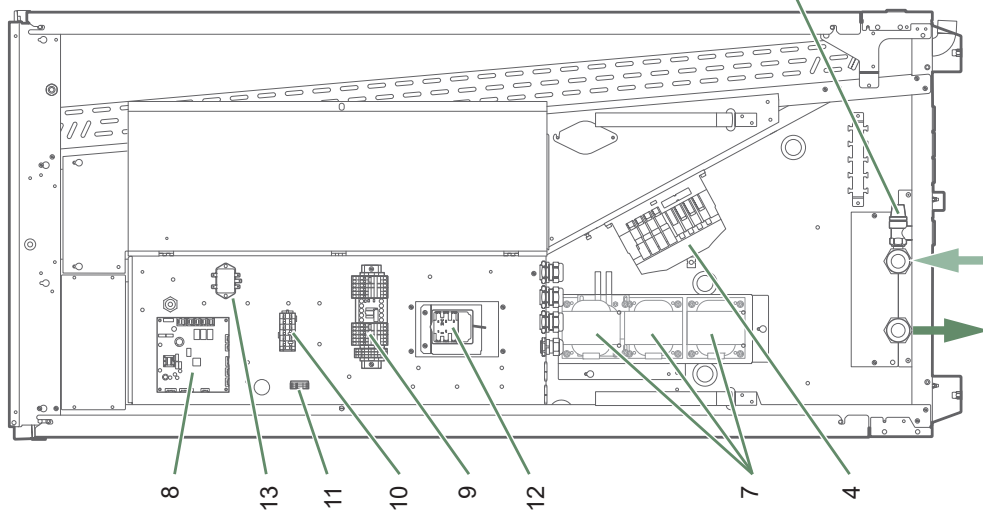







1. Heat exchanger (with electrical backup)
2. Compressor
3. Automatic bleeder valve
4. Driver
5. High performance and low noise fan
6. Exchange surface evaporator
7. **Choke (s)**
8. SEC board

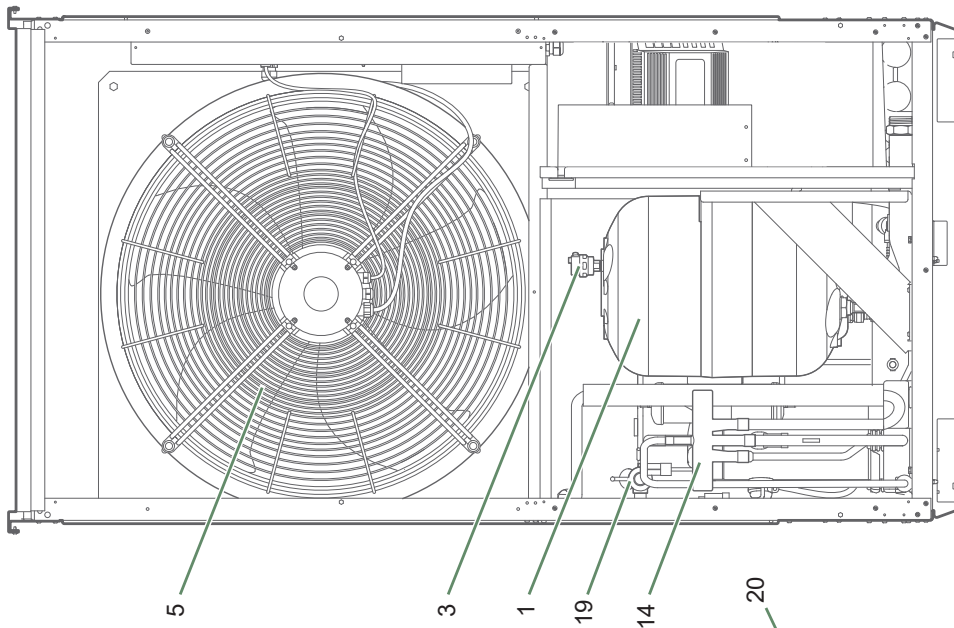

9. Supply terminal
10. Accessories terminal
11. Modbus terminal
12. Electrical backup thermostat
13. Filter
14. 4-way valve
15. Pressure thermostat
16. Low pressure thermostat

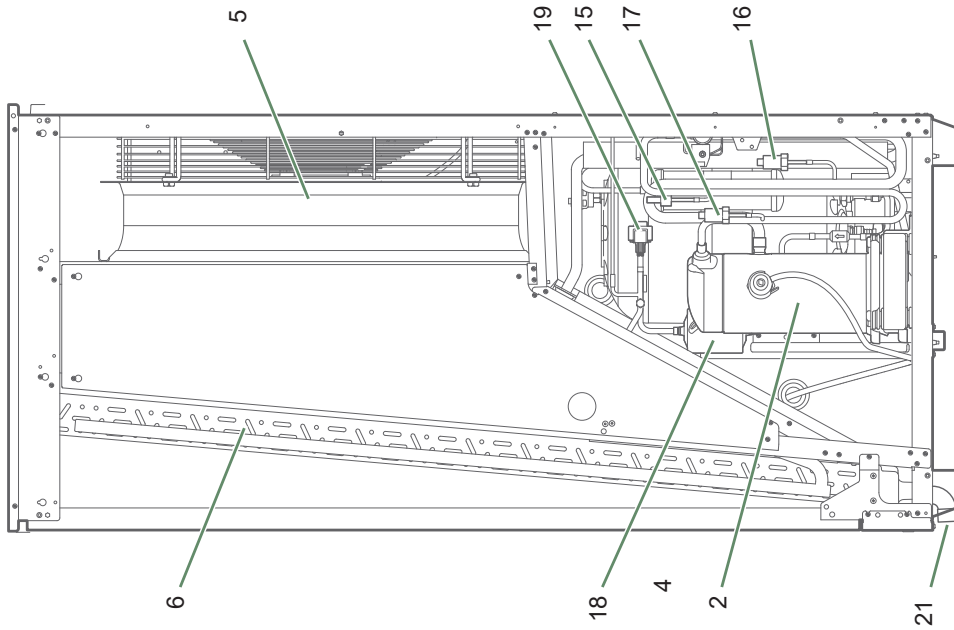



17. High pressure thermostat
18. Bi-flow filter (dehydrator)
19. Expansion valve
20. Safety valve
21. Condensate evacuation

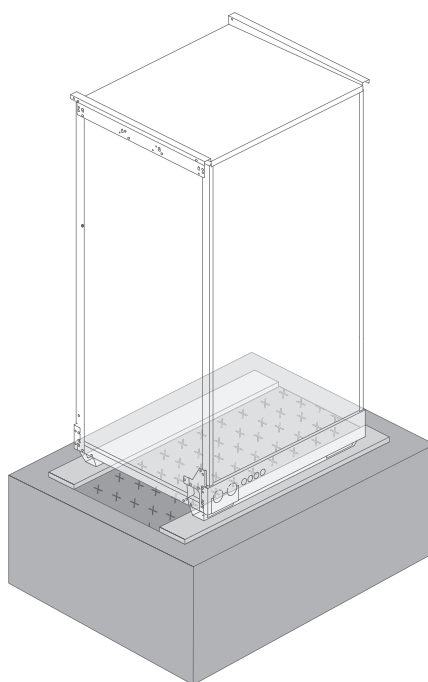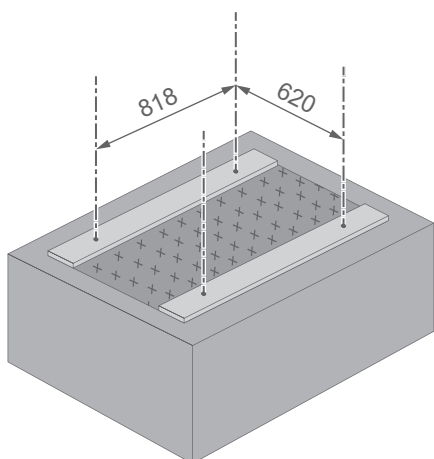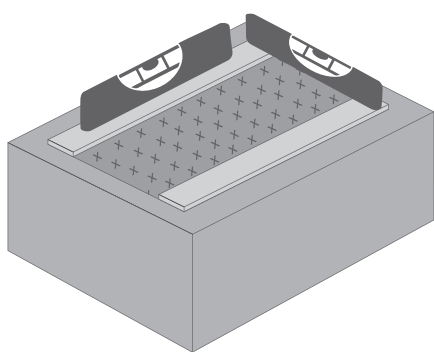
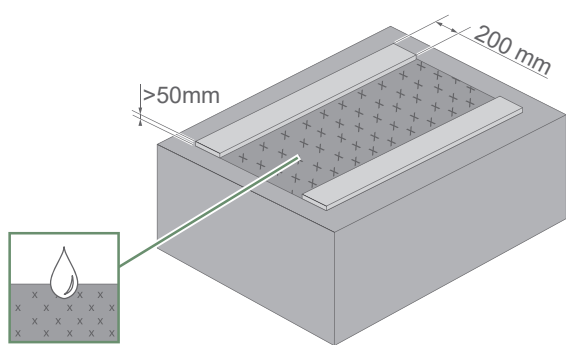
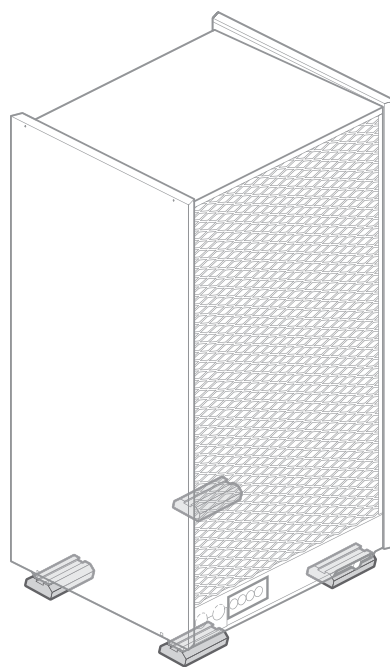
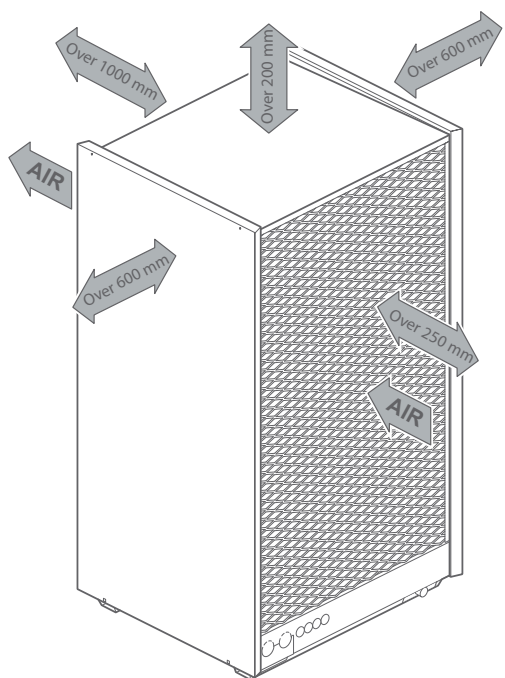




IXTRA M 12-15





IXTRA M 12tri-15tri-17tri

250 kg



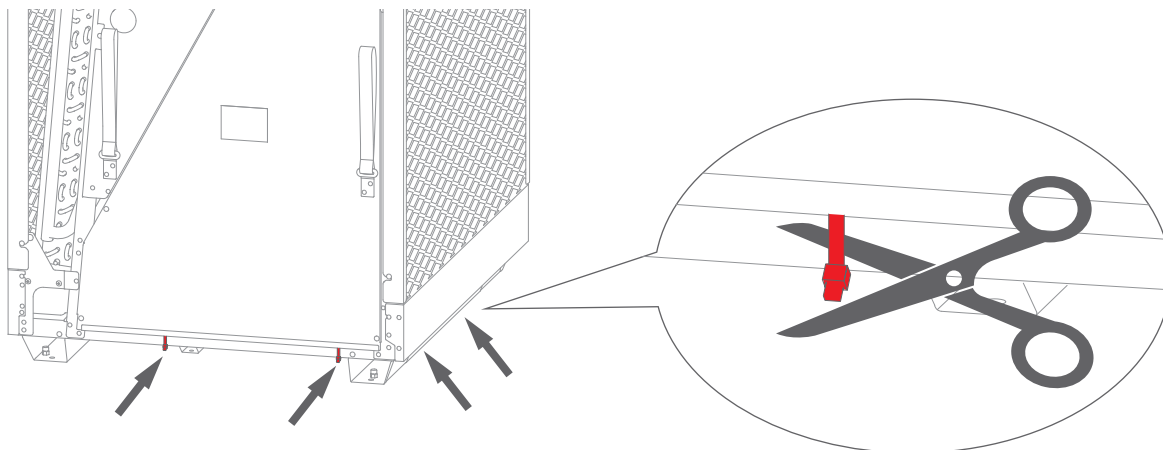
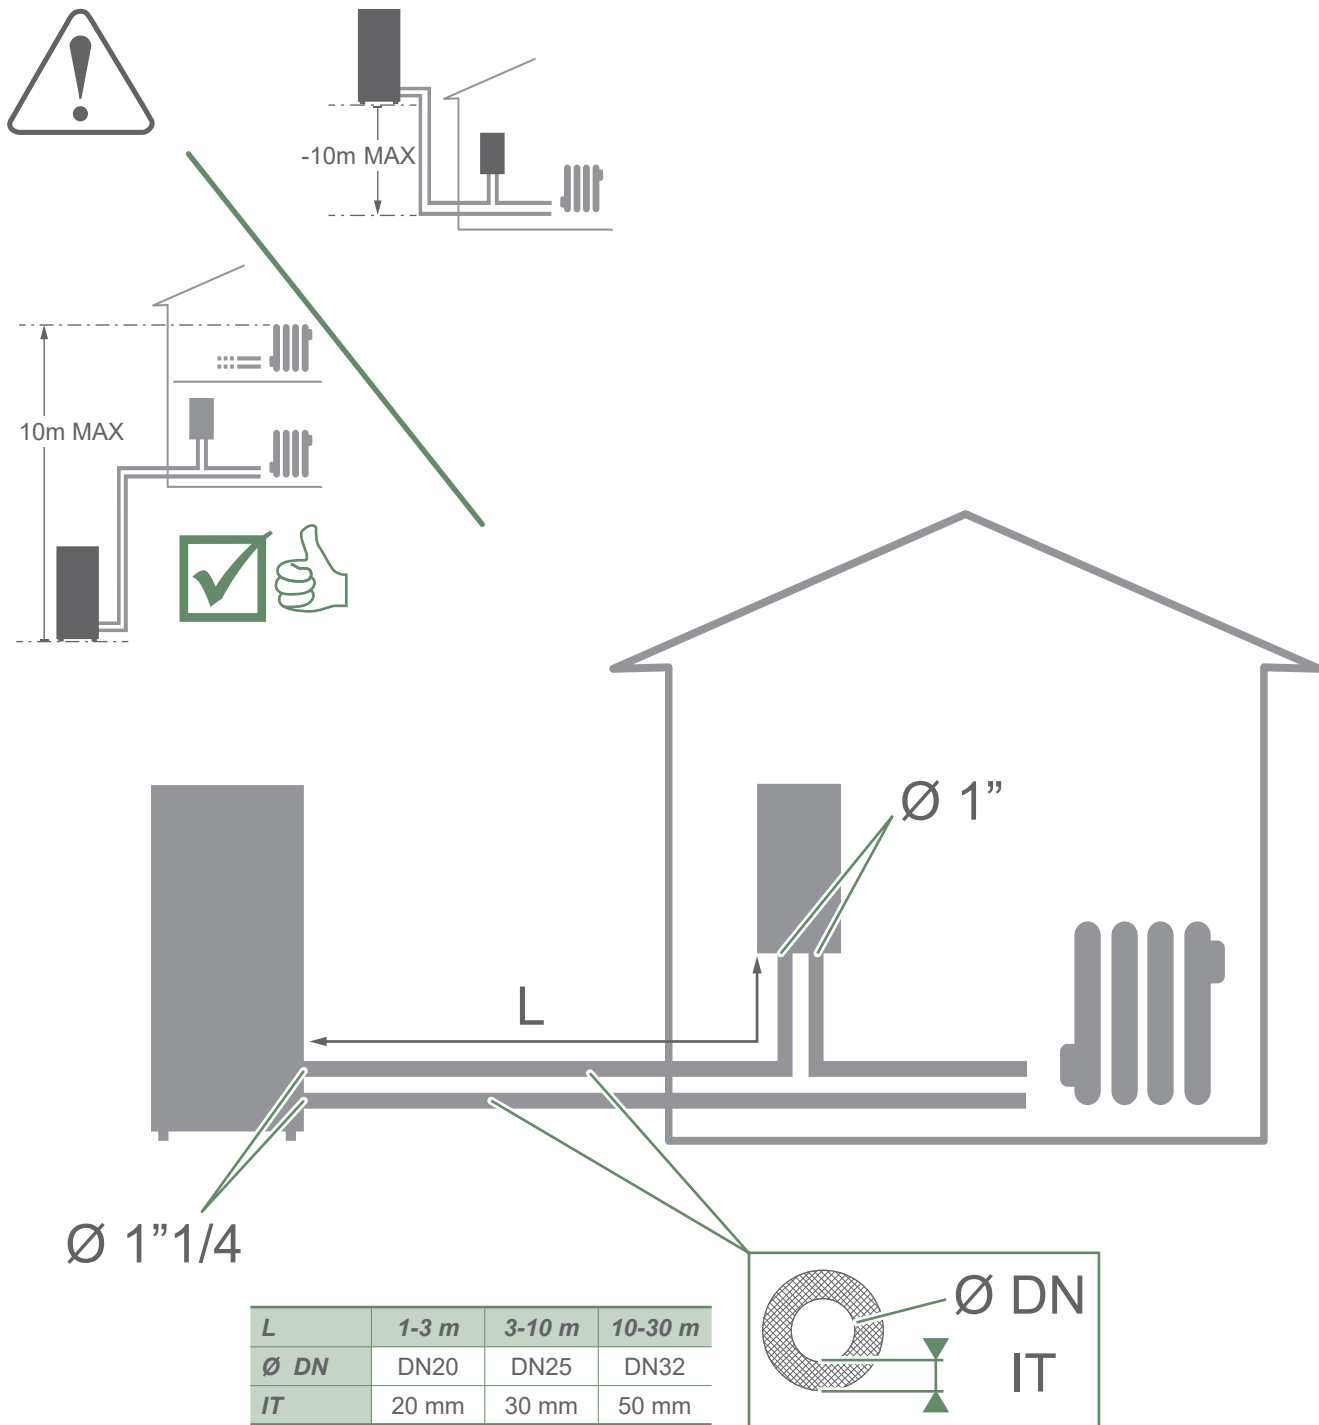


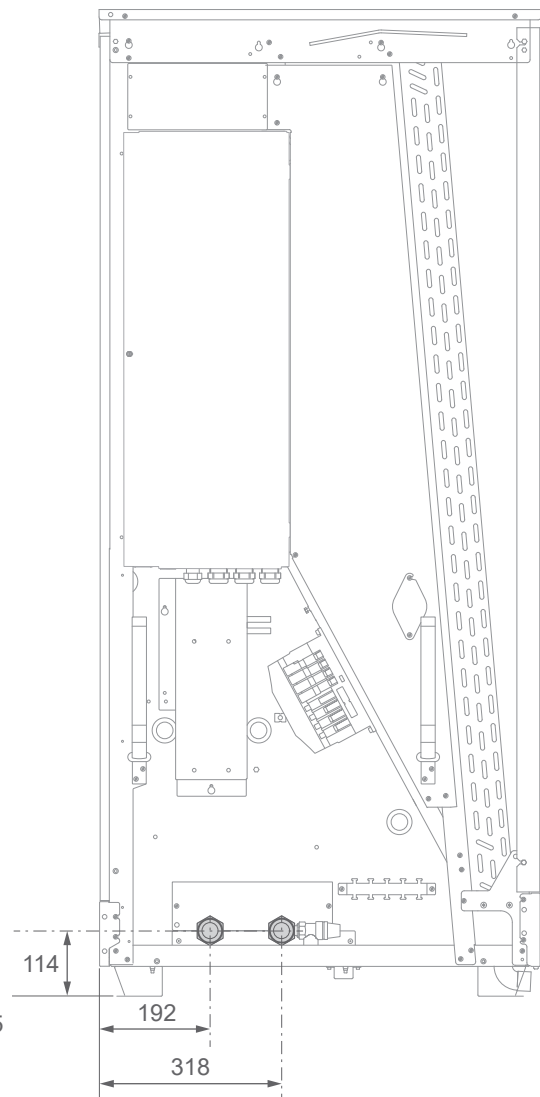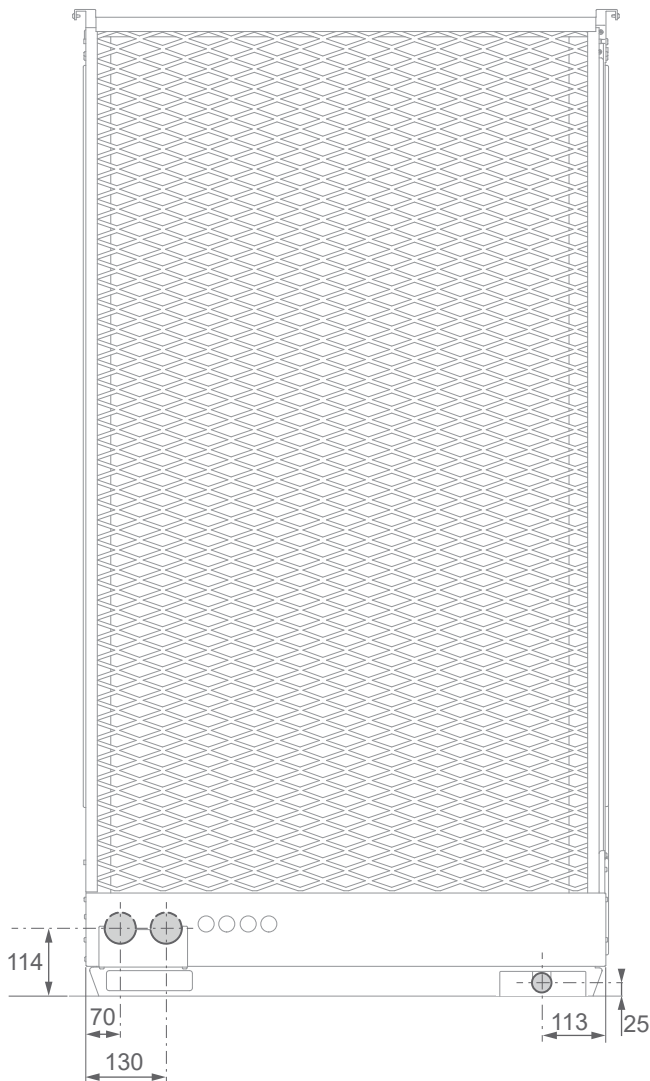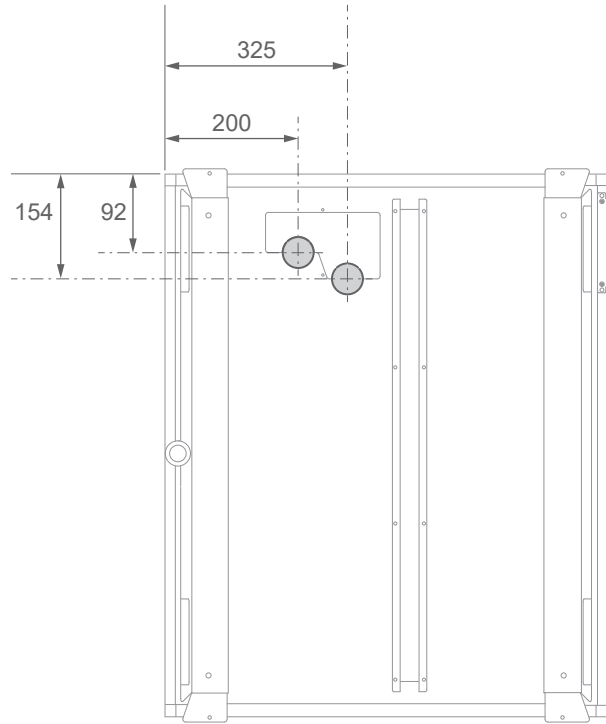


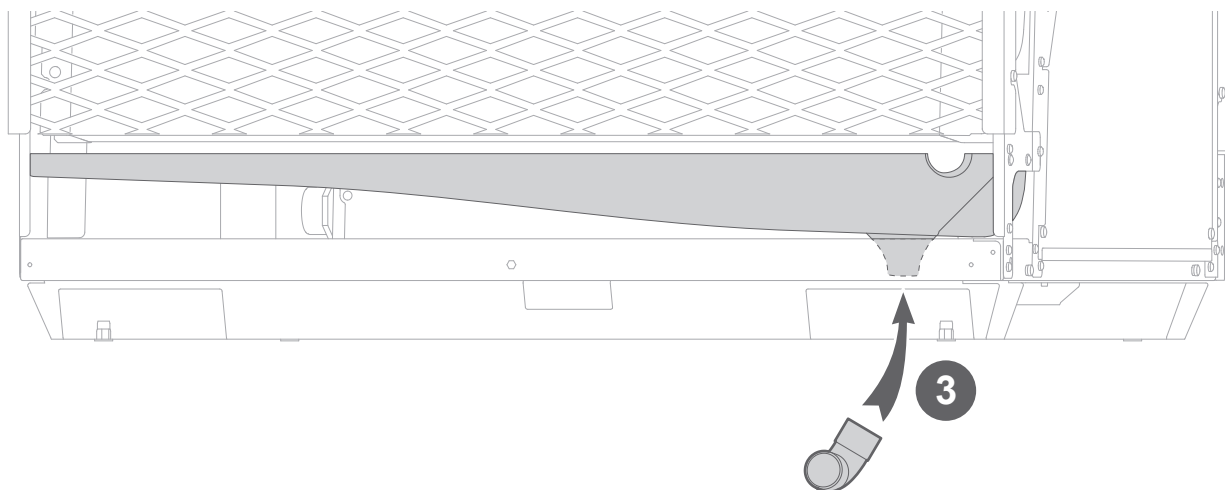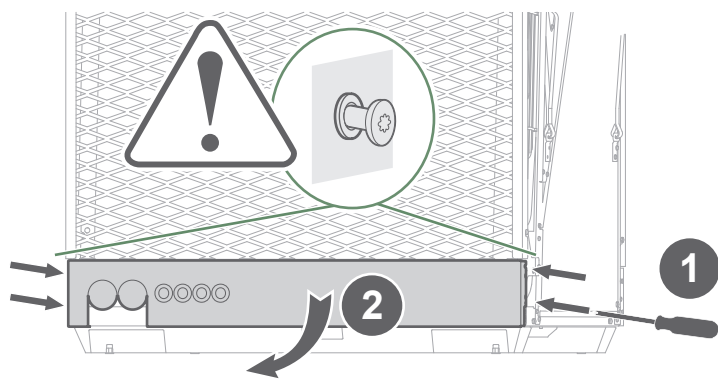




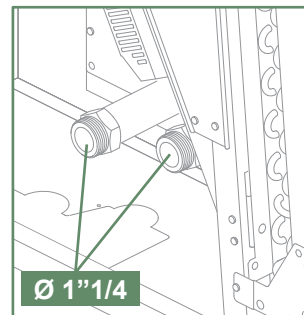

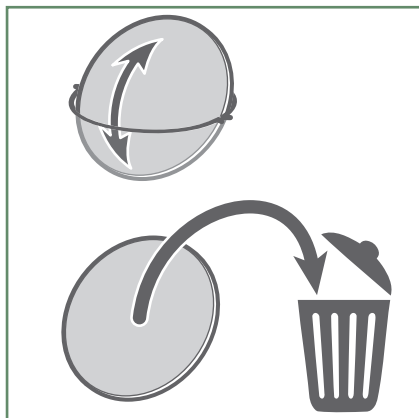
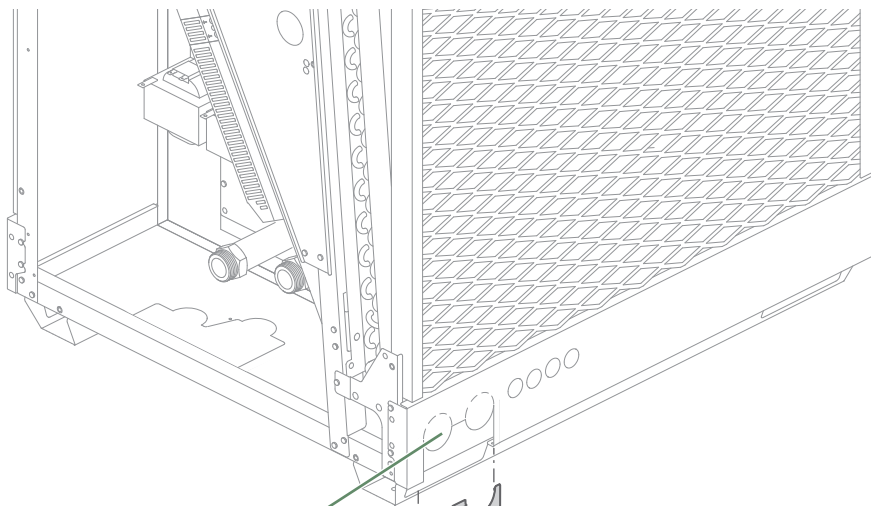




Ø 1"1/4

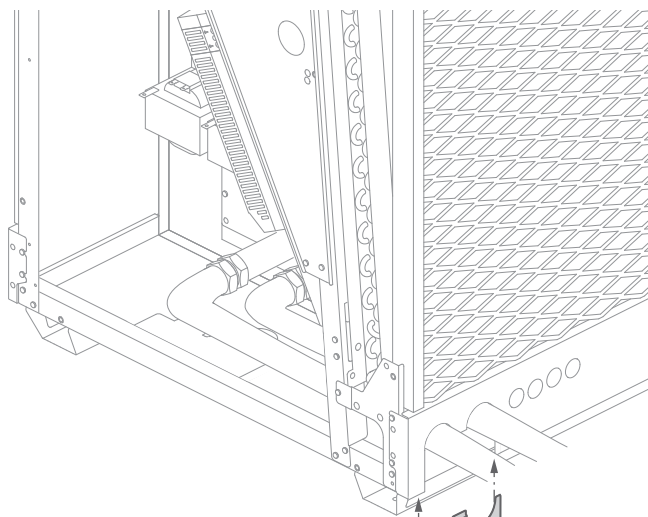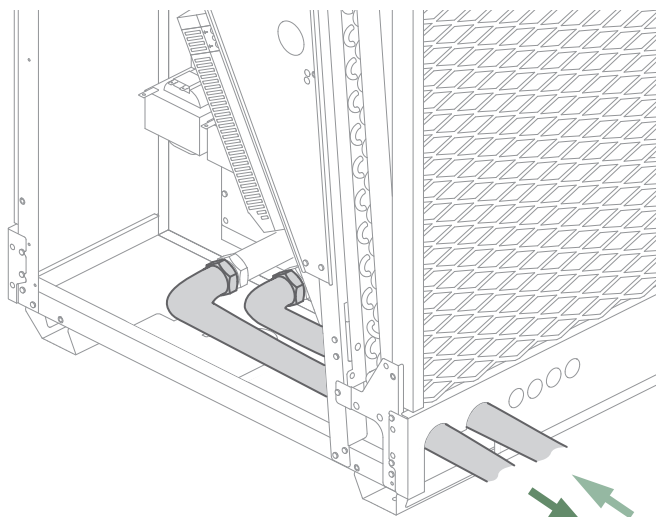


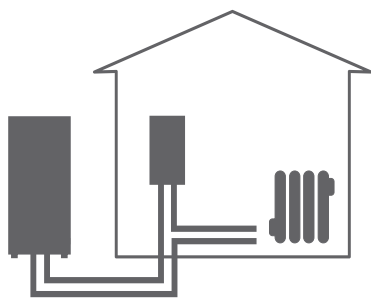







X 2
TX20

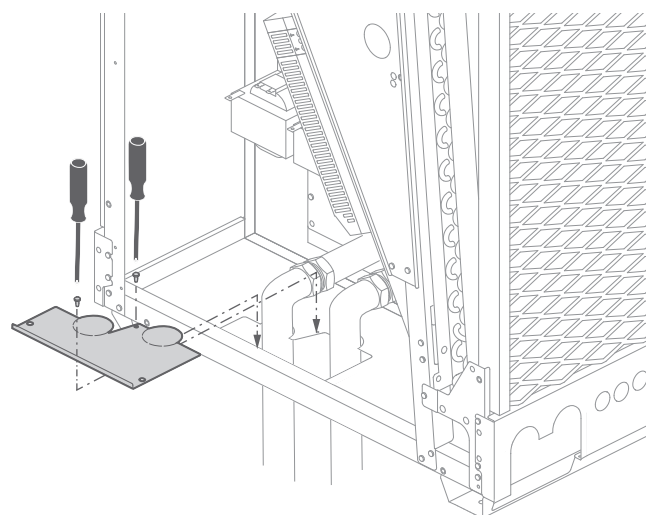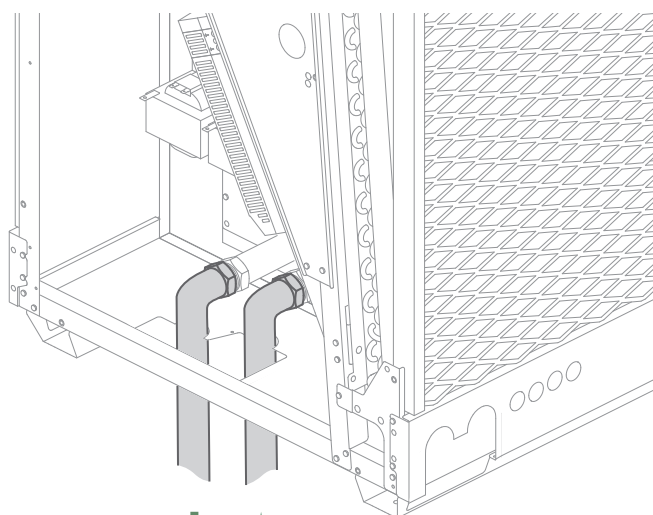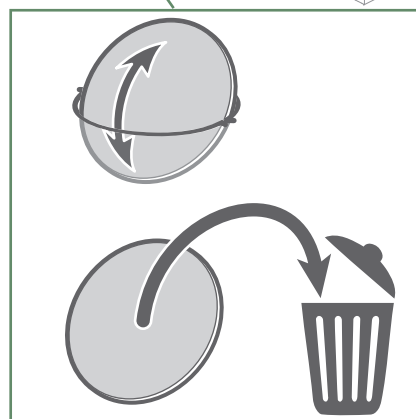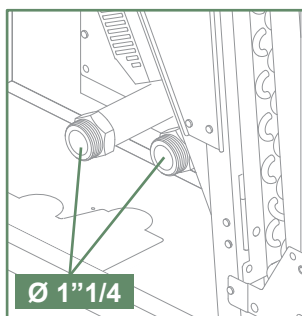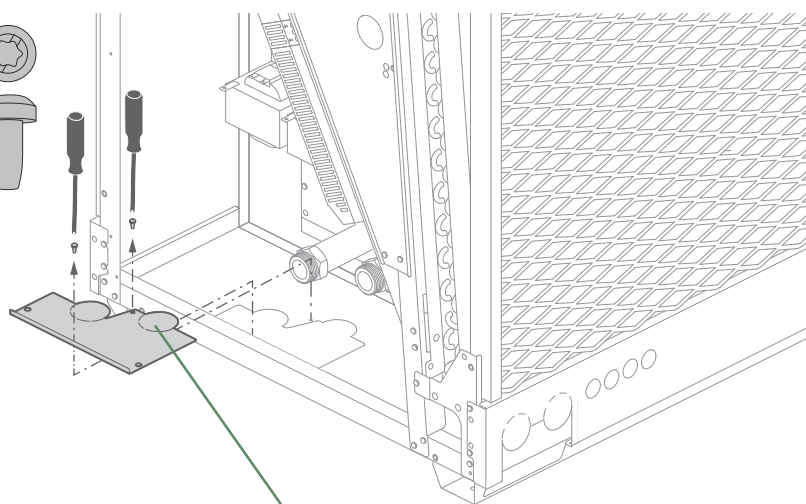



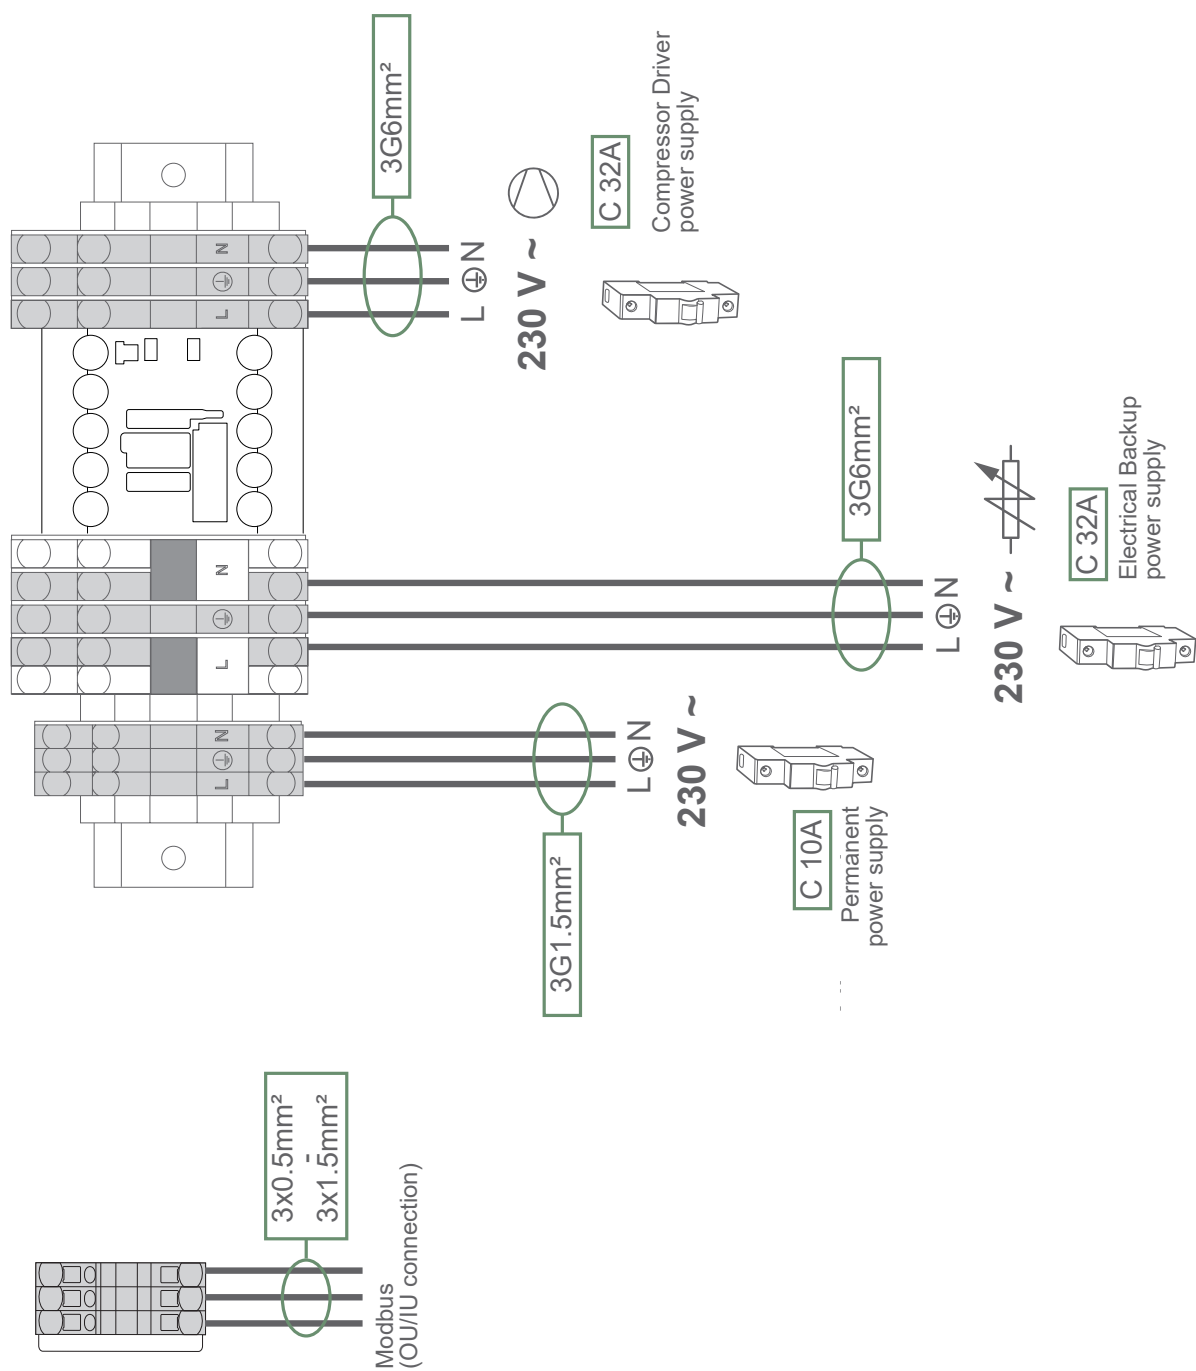


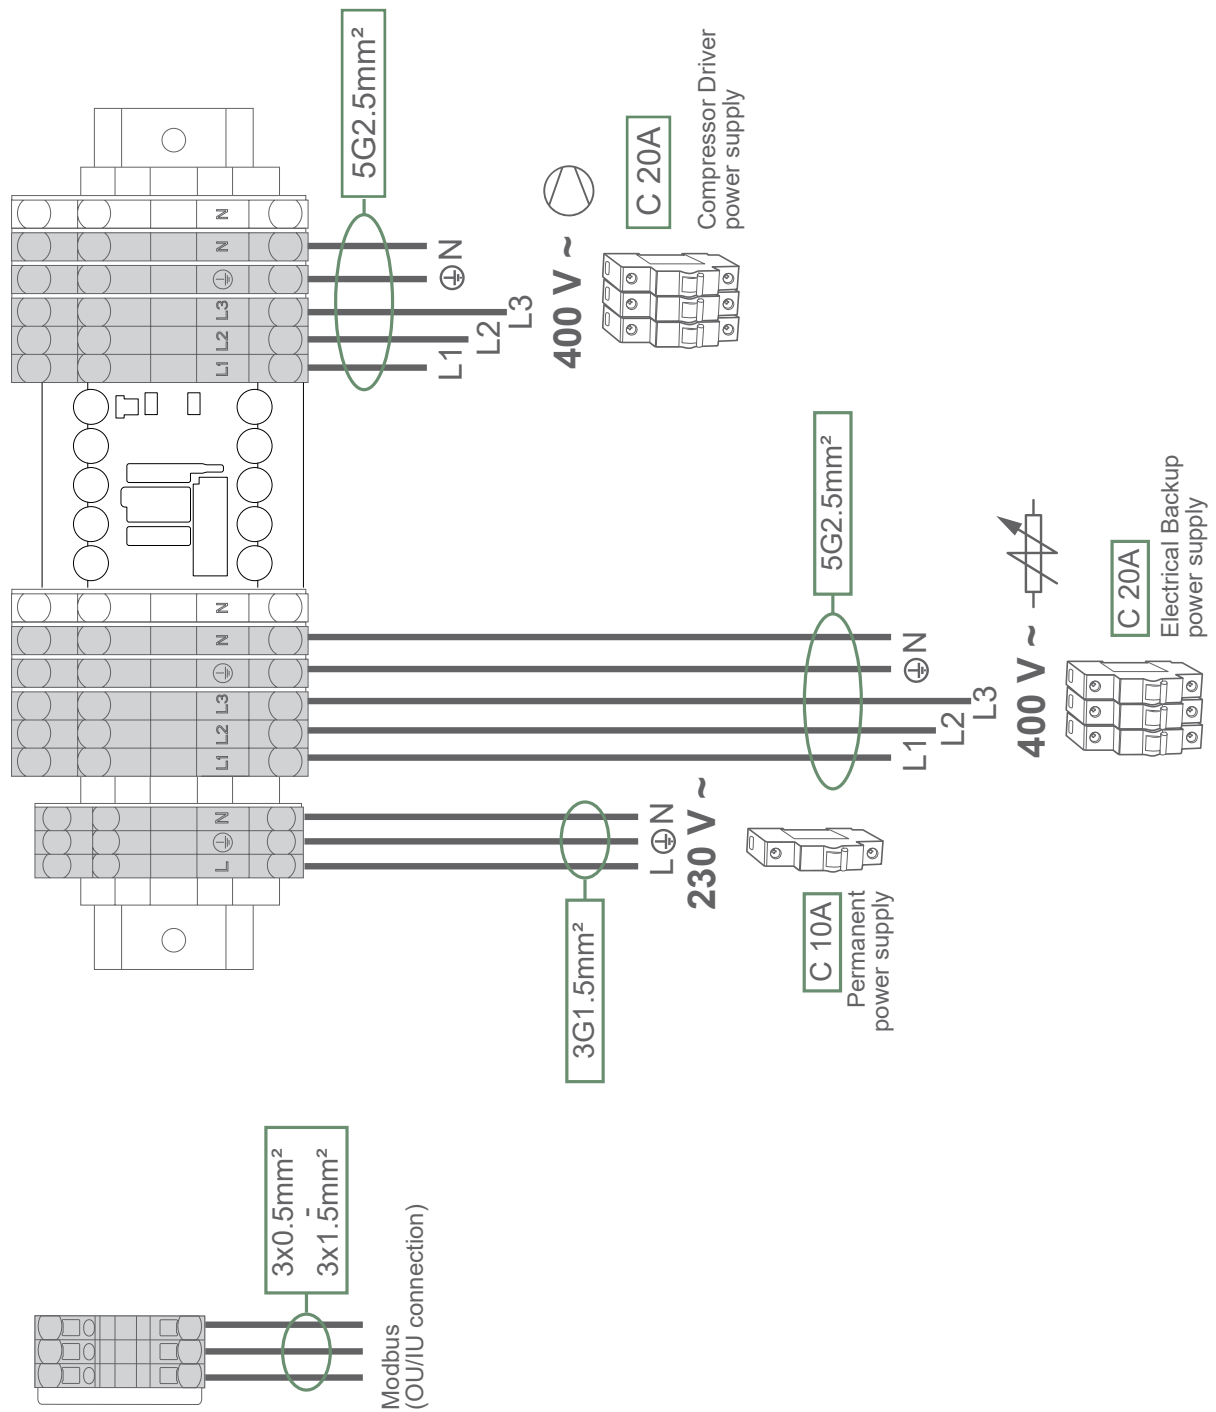


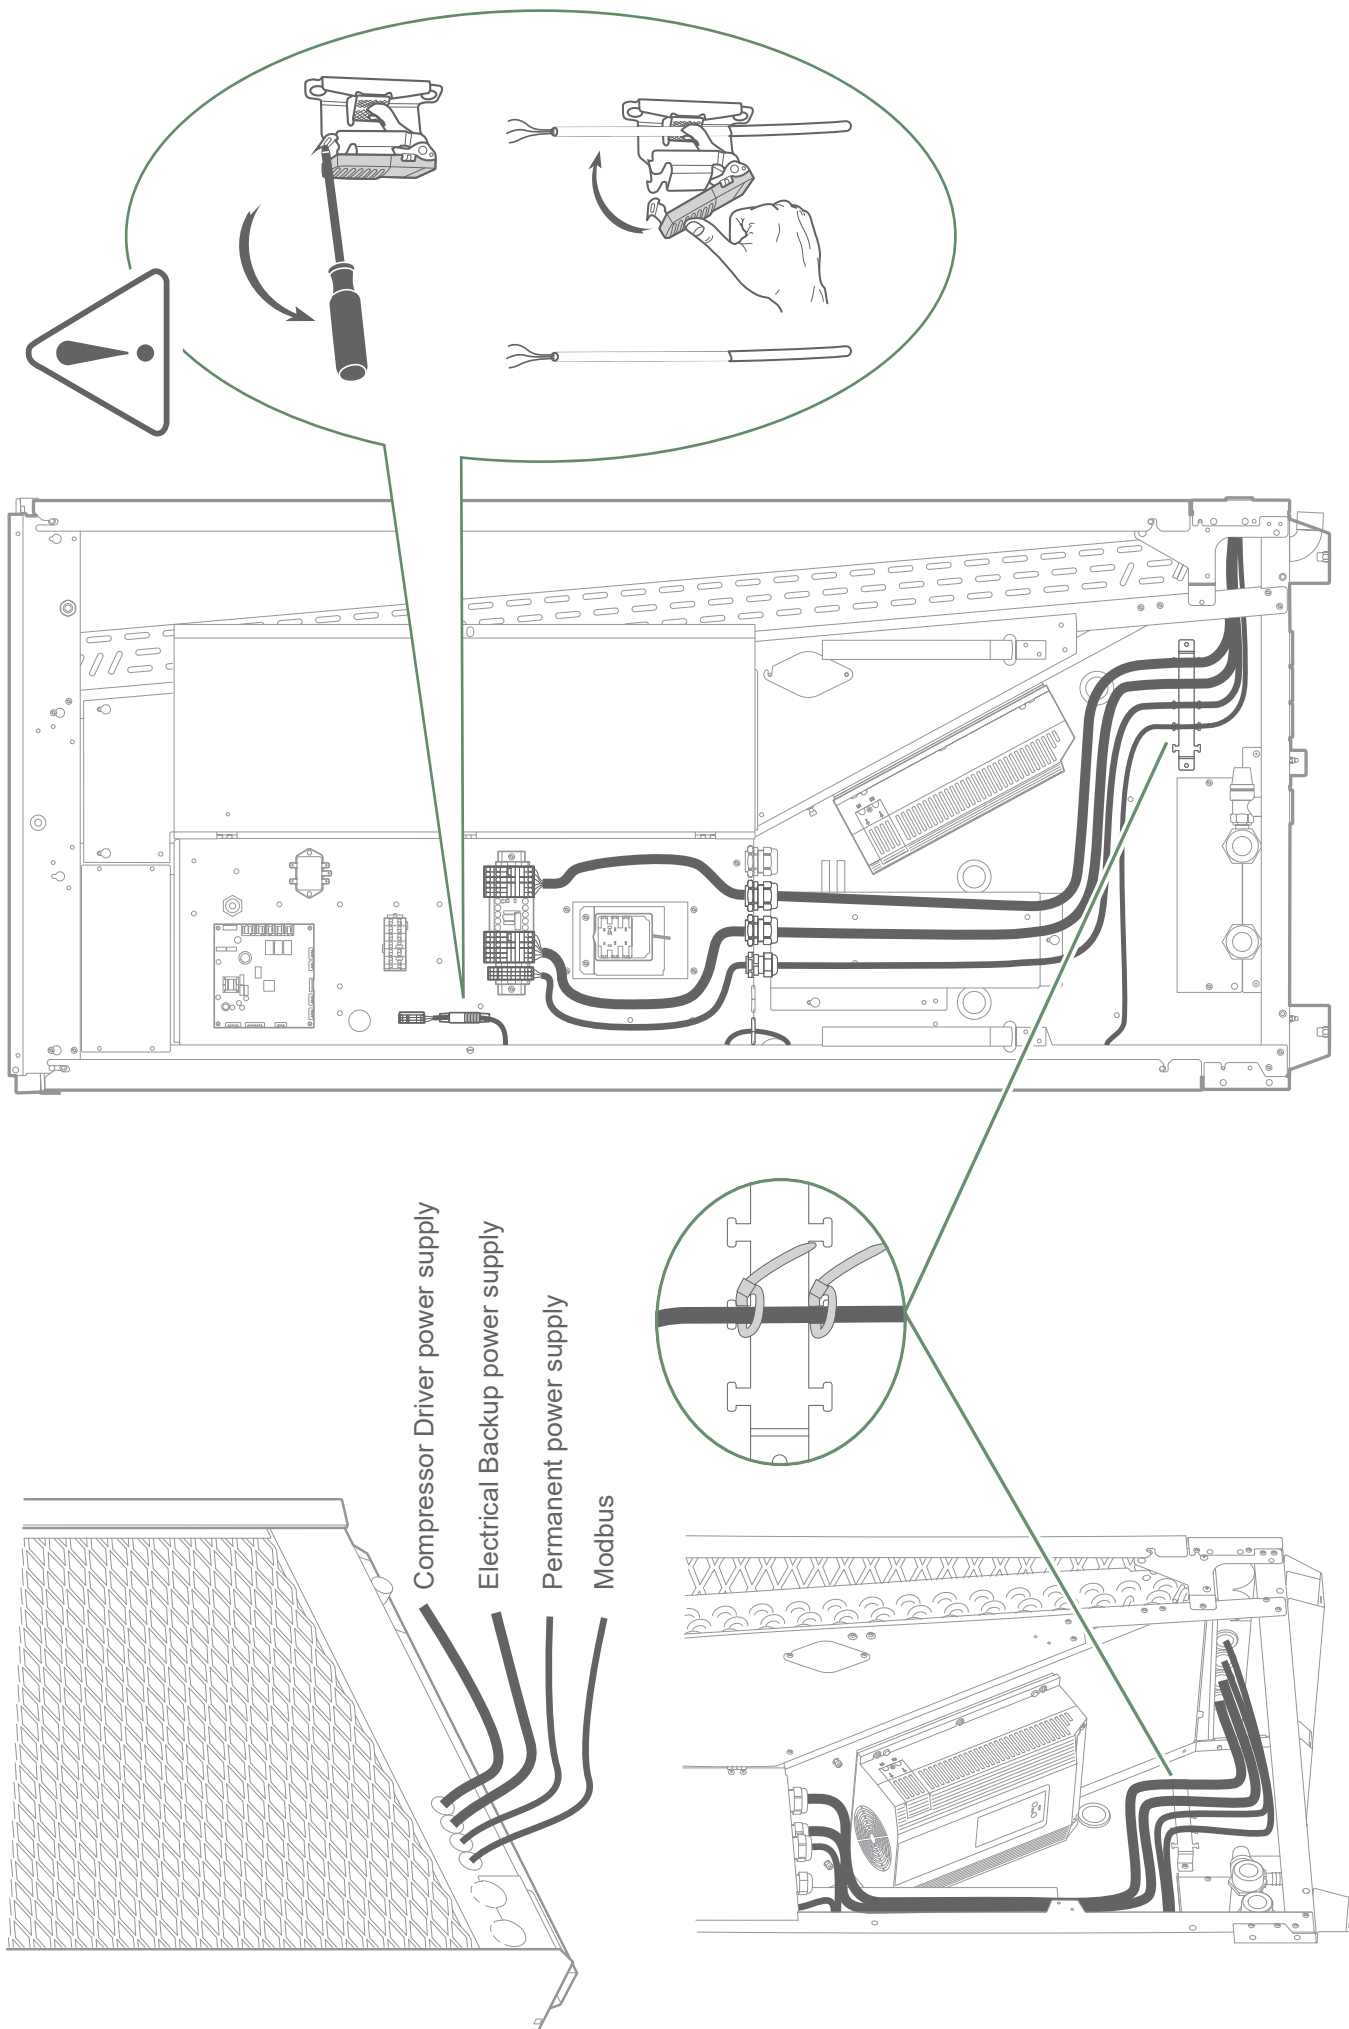

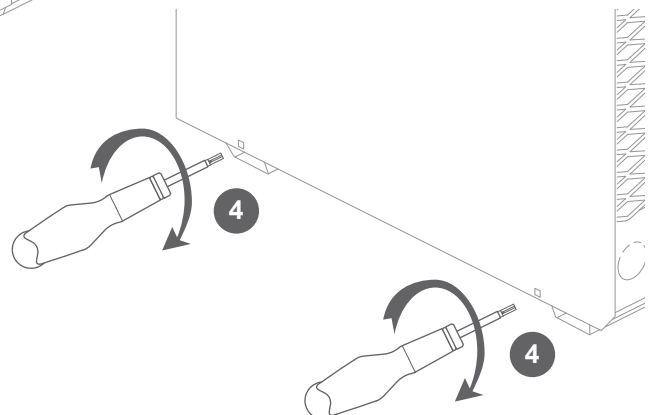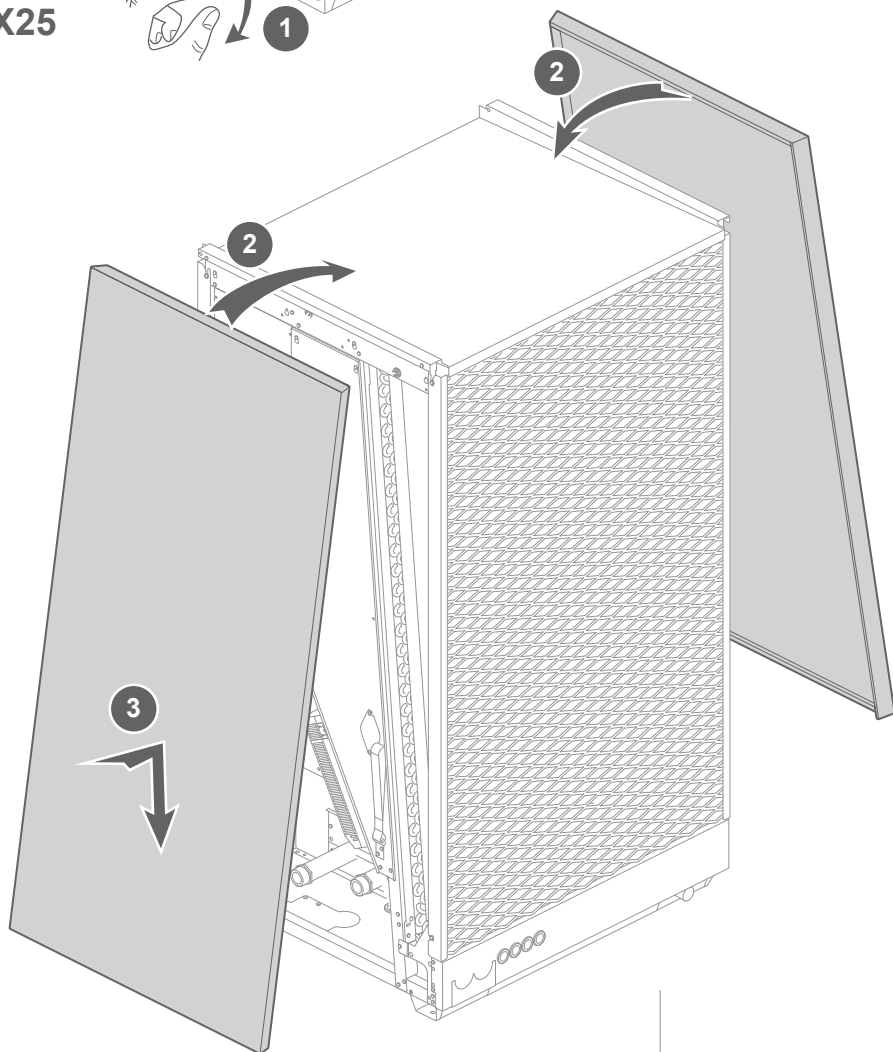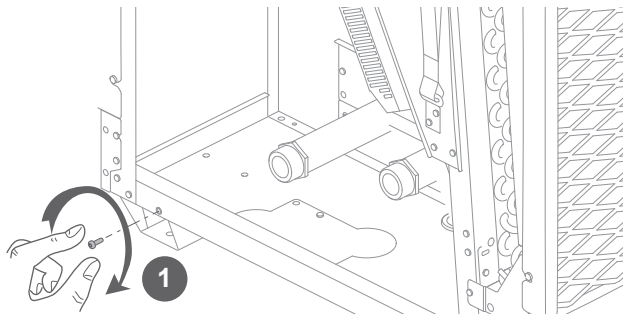

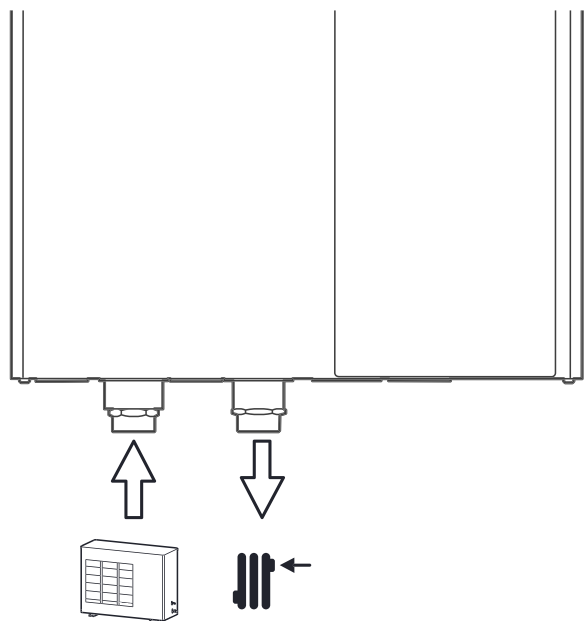

15 - 35 Nm

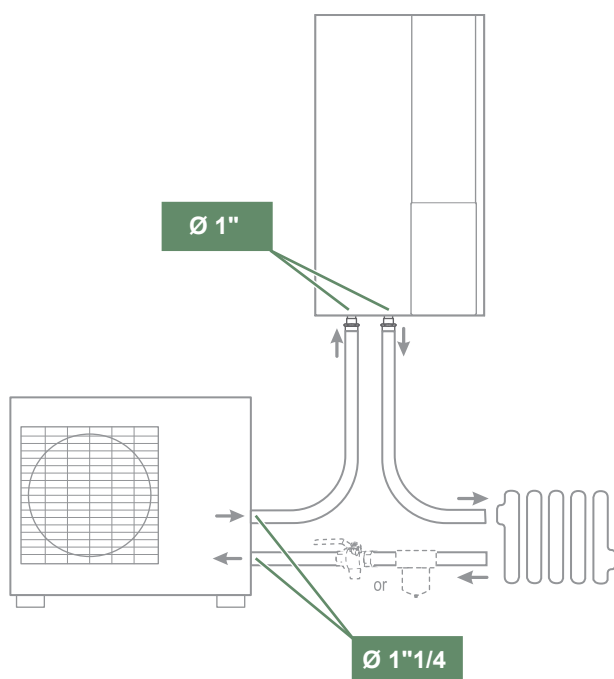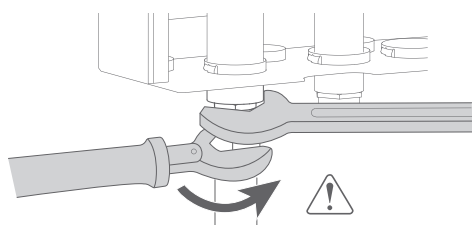



A series of horizontal dotted lines spanning the width of the page, providing a guide for handwriting practice.

Commissioning date:

Address of your heating installer or customer service.



Keymark Certification :

IXTRA M 12 - 012-C700146 / IXTRA M 15 - 012-C700147

IXTRA M 12tri - 012-C700148 / IXTRA M 15tri - 012-C700149 / IXTRA M 17tri - 012-C700144



This equipment complies with:

- Low Voltage Directive 2014/35/EC in accordance with NF EN 60335-1, NF EN 60335-2-40, NF EN 60529, NF EN 60529/A2 (PI) standards,
- Electromechanical Compatibility Directive 2014/30/EC,
- Machines Directive 2006/42/EC,
- Pressure Equipment Directive 2014/68/EC in accordance with NF EN 378-2 standard,
- Ecodesign Directive 2009/125/EC,
- Energy Labelling Directive 2010/30/EC.

This appliance also complies with:

- Decree No. 92-1271 (and its modifications) relating to certain refrigeration fluids used in refrigeration and air conditioning equipment.
- Regulation 842/2006 of the European parliament on certain fluorinated greenhouse gases.
- The standards relating to the product and the testing methods used: Air-conditioners, refrigeration units and heat pumps with compressor driven by electric motor for heating and refrigeration EN 14511-1, 14511-2, 14511-3, and 14511-4.
- Standard XP ENV 12102: Air-conditioners, heat pumps and dehumidifiers with compressor driven by electric motor. Measurement of airborne noise. Determination of acoustic power level.



FR

Cet appareil,
ses accessoires,
piles et cordons
se recyclent

REPRISE
À LA LIVRAISON

À DÉPOSER
EN MAGASIN

À DÉPOSER
EN DÉCHÈTERIE

Points de collecte sur www.quefairedemesdechets.fr